


JBP HH WATER SYSTEM: NORMAL CONDITIONS

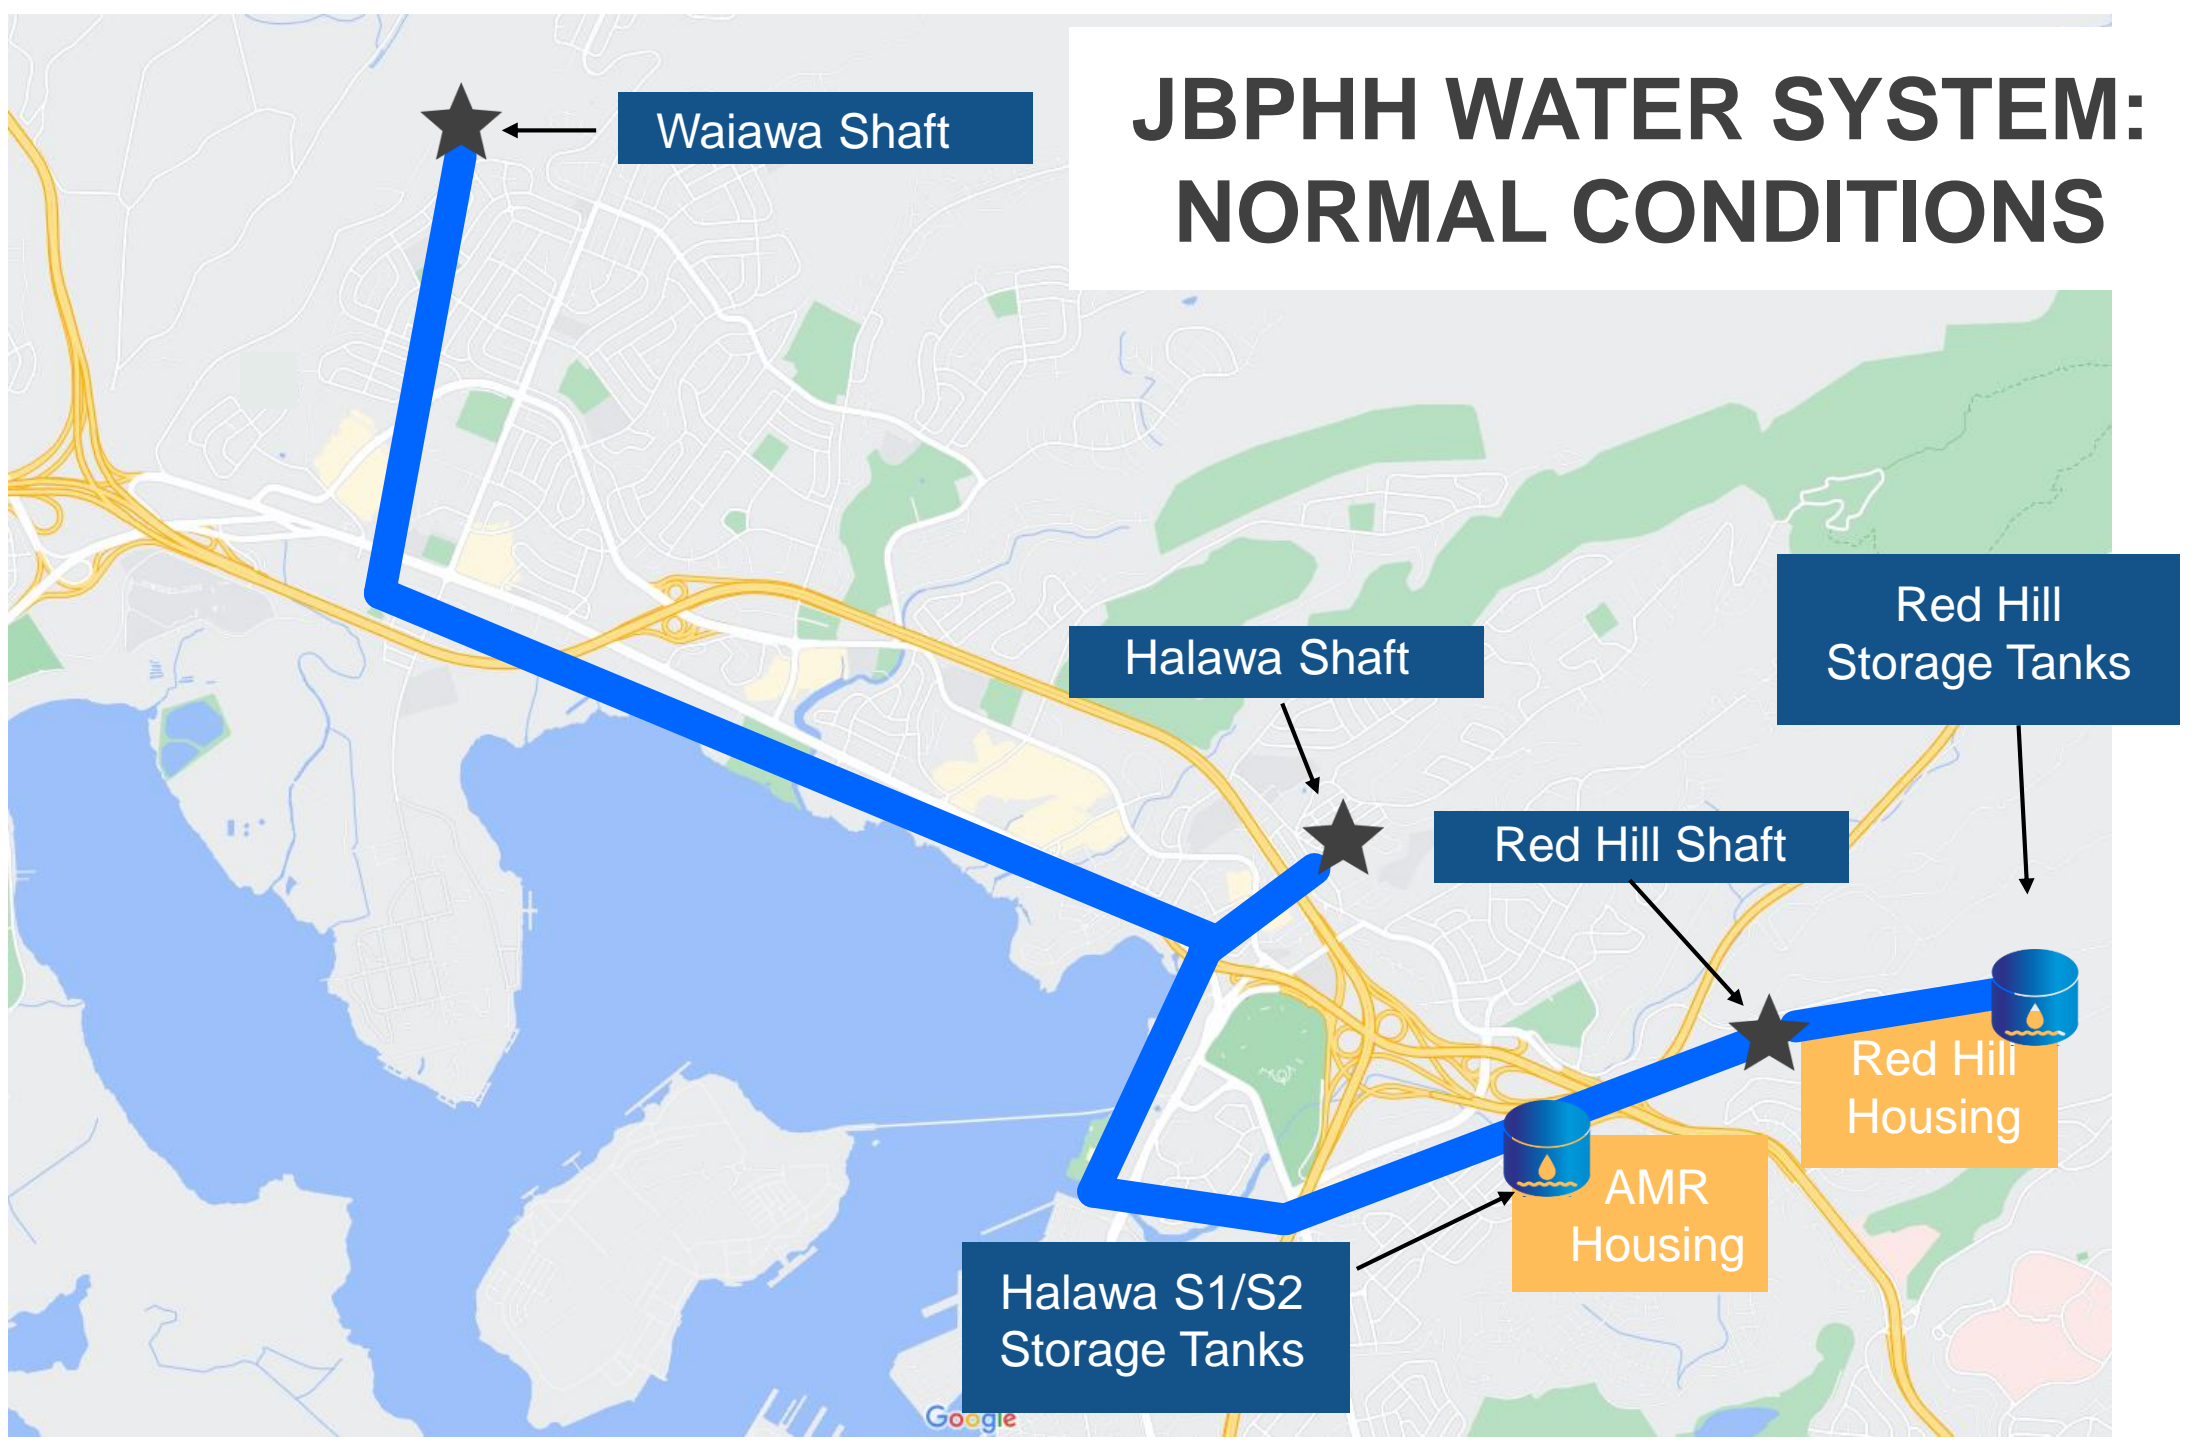

JBP HH WATER SYSTEM: CURRENT CONDITIONS

Waiawa Shaft
is the Primary
water source

Navy
transmission
lines feeding
AMR & Red Hill

Halawa Shaft
closed out of
an abundance
of caution


Red Hill Shaft
closed due to
contamination

Red Hill tanks supply water
to Red Hill Mauka Community

Halawa tanks
supply water to AMR

AMR
Housing


Red Hill
Housing

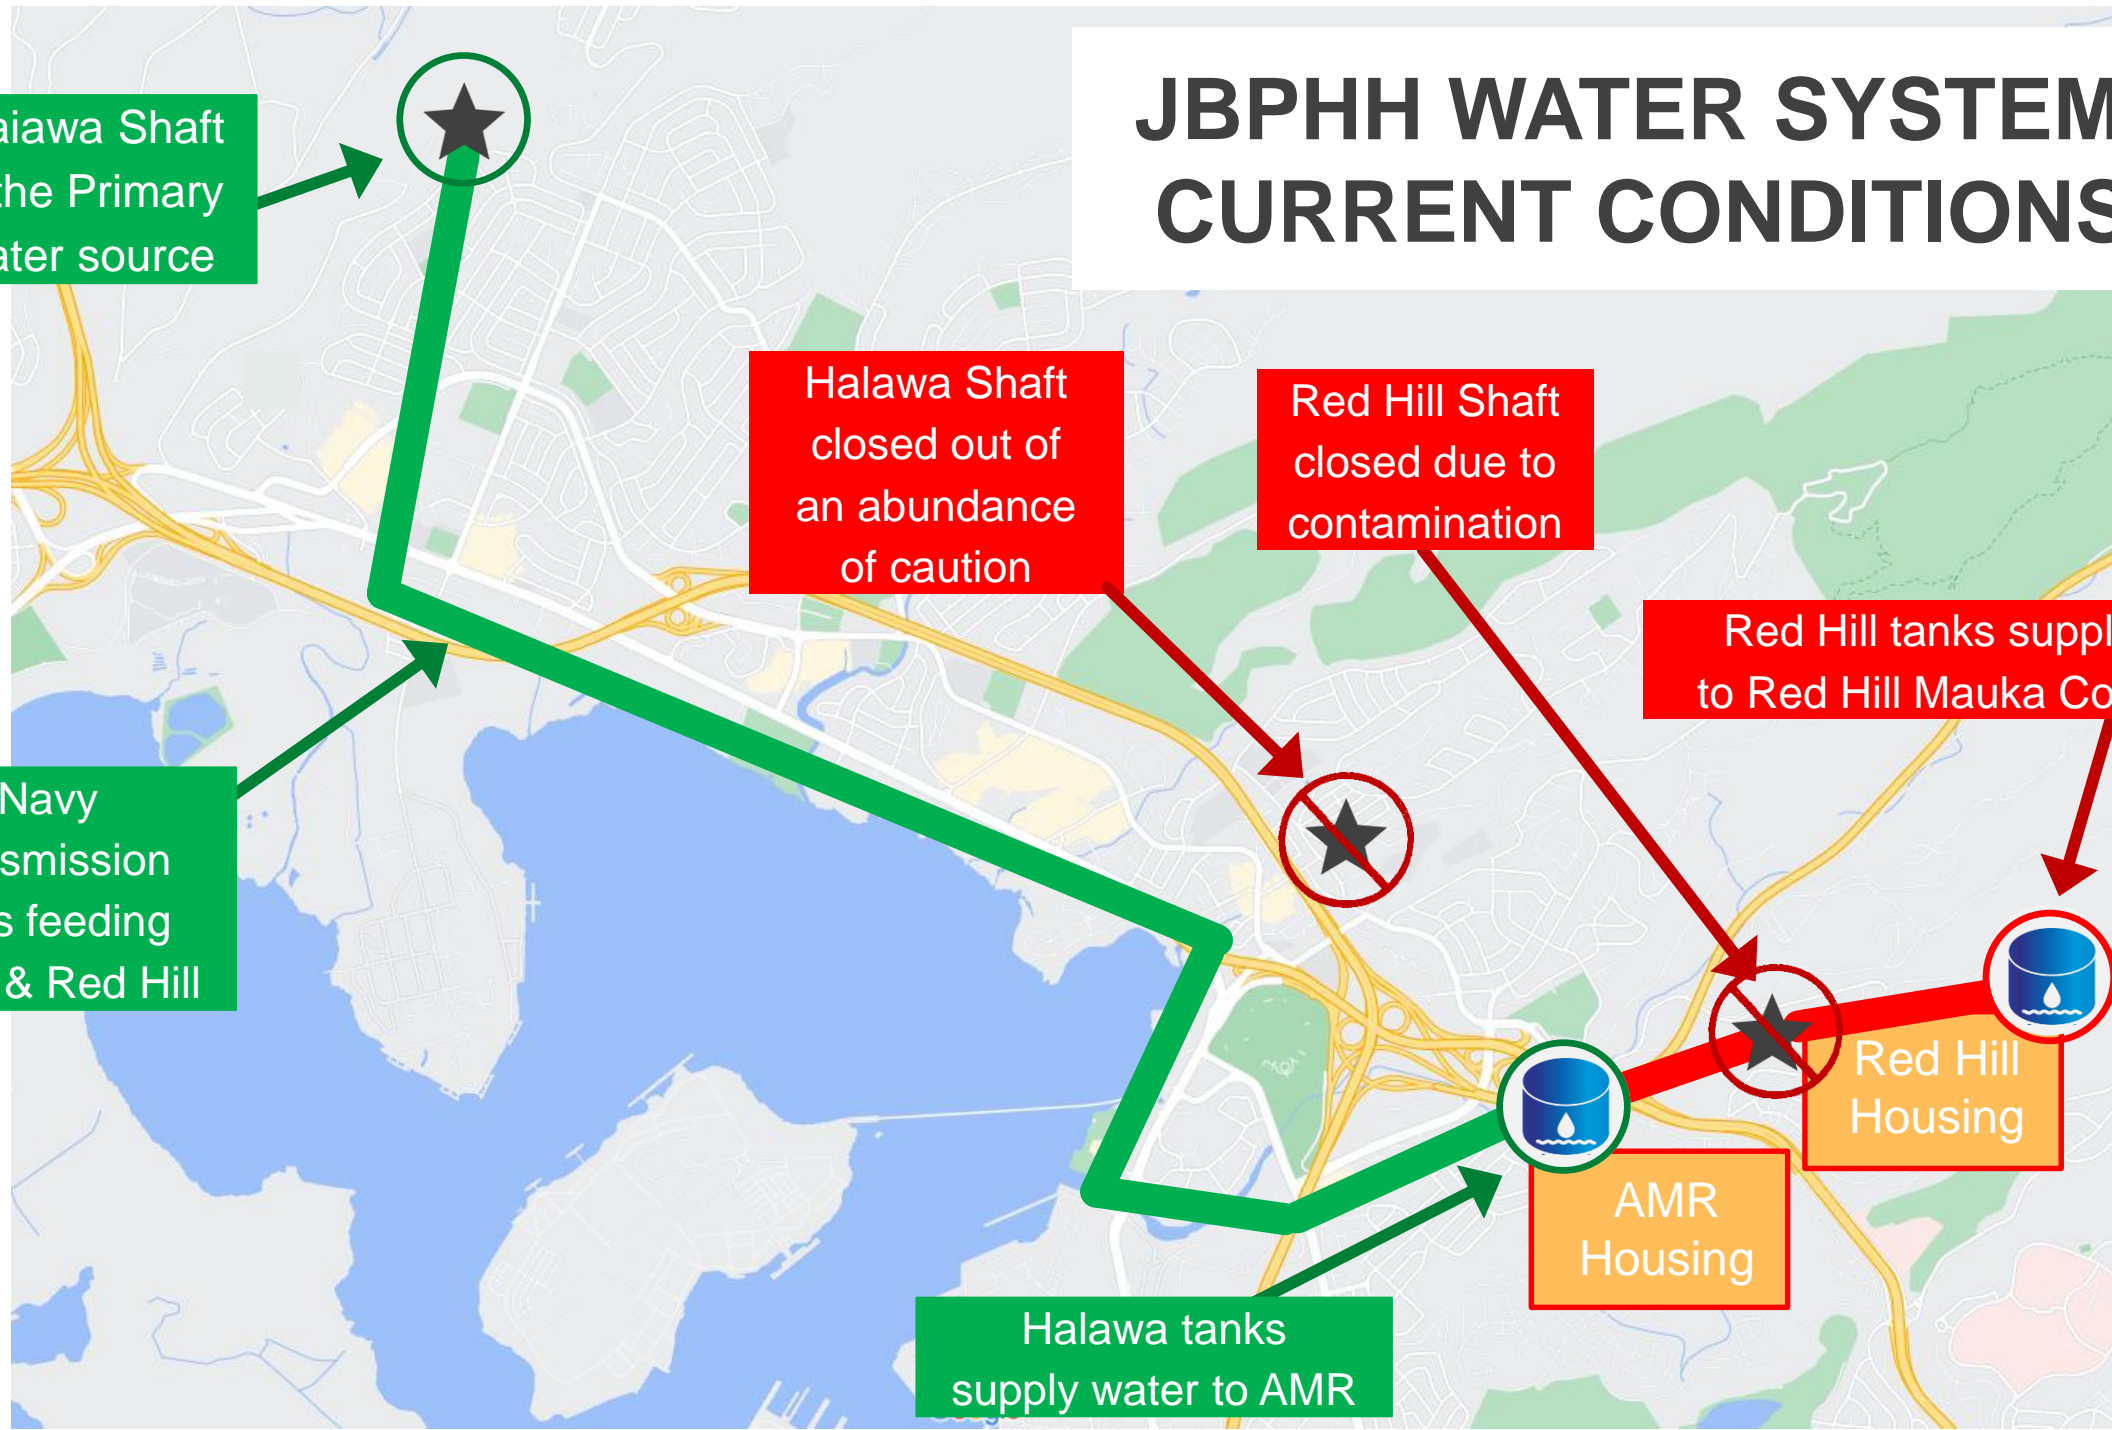

THE PLAN TO “RENDER SAFE” AMR & RED HILL

- U.S. Army Pacific has committed to support the Pacific Fleet to provide safe drinking water to families living in AMR and Red Hills communities.
- This will occur in 2 phases. These phases can occur simultaneously.
- Sampling and testing will occur within each phase to verify improvements to the water system

Flush the system

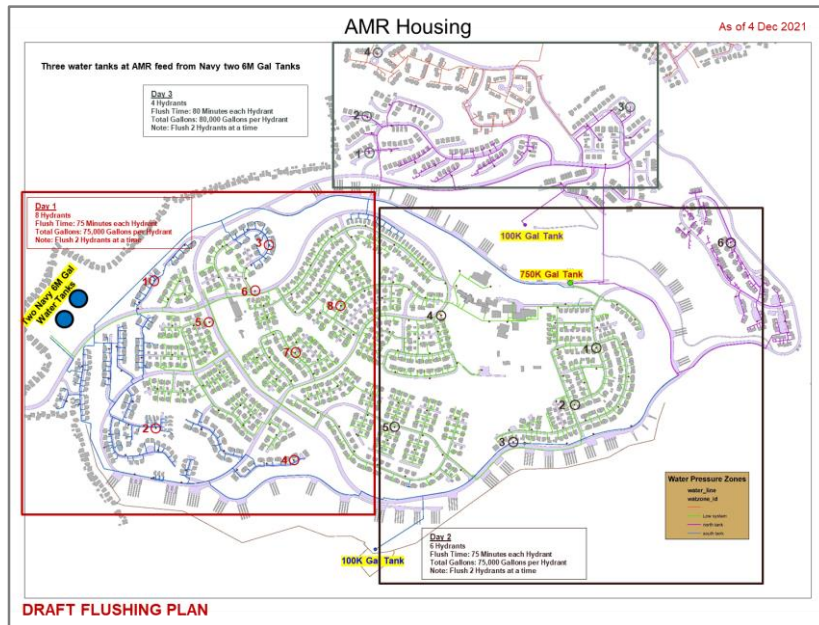


Filter the system




THE PLAN TO “RENDER SAFE” AMR & RED HILL

Flush:

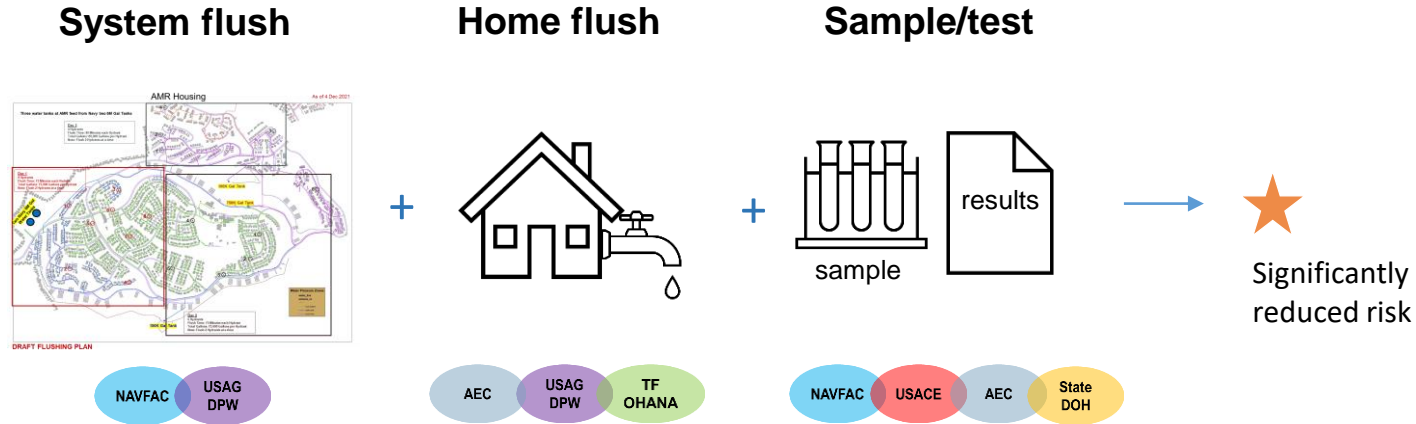

Filter:


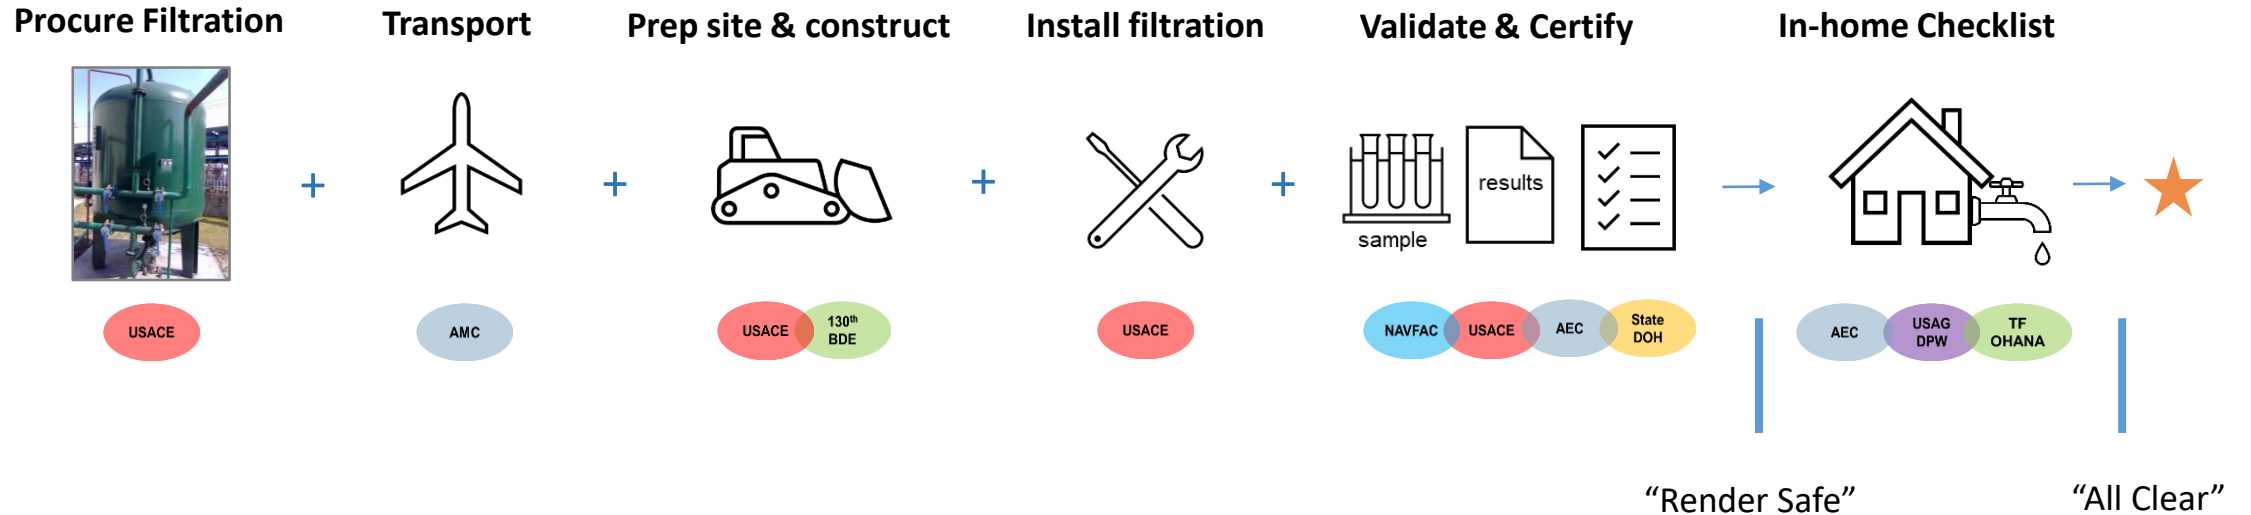




UNCLASSIFIED



AMR/Red Hill – Way Forward

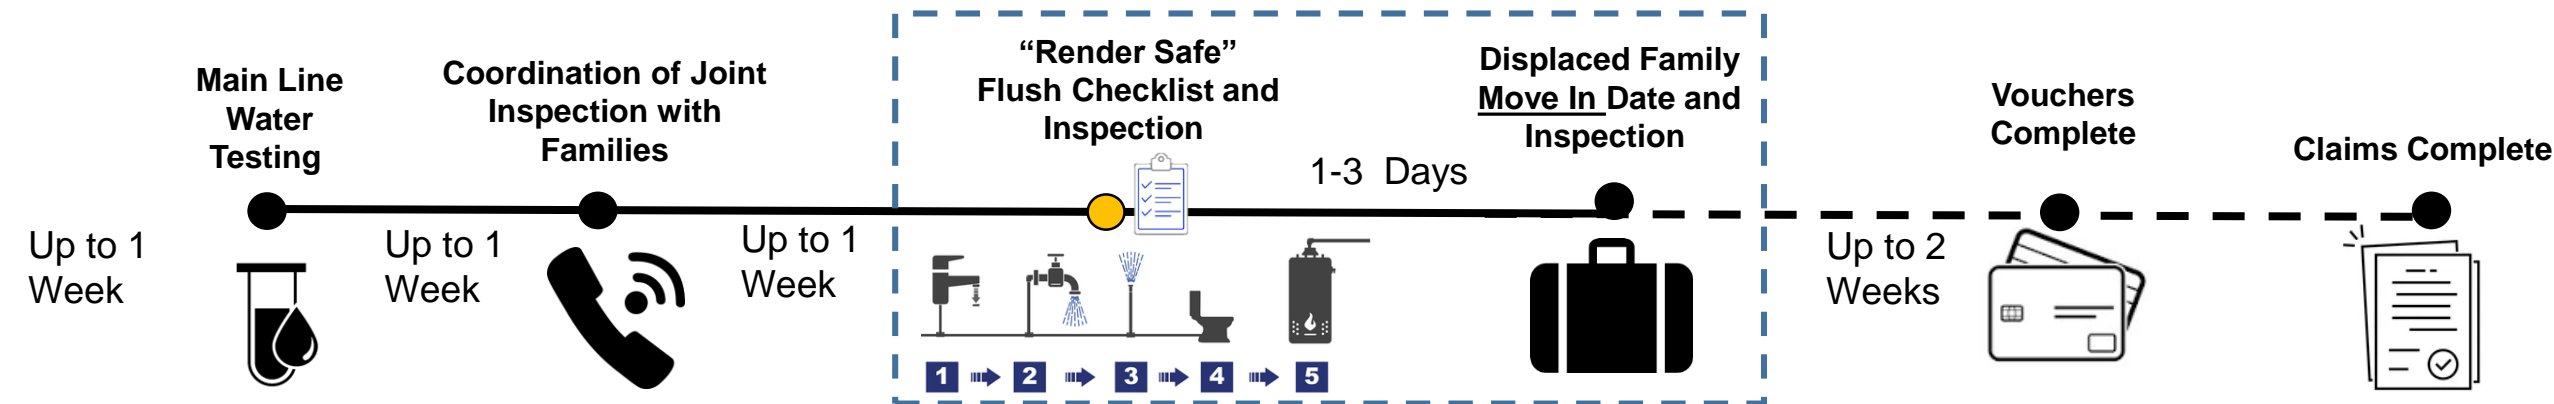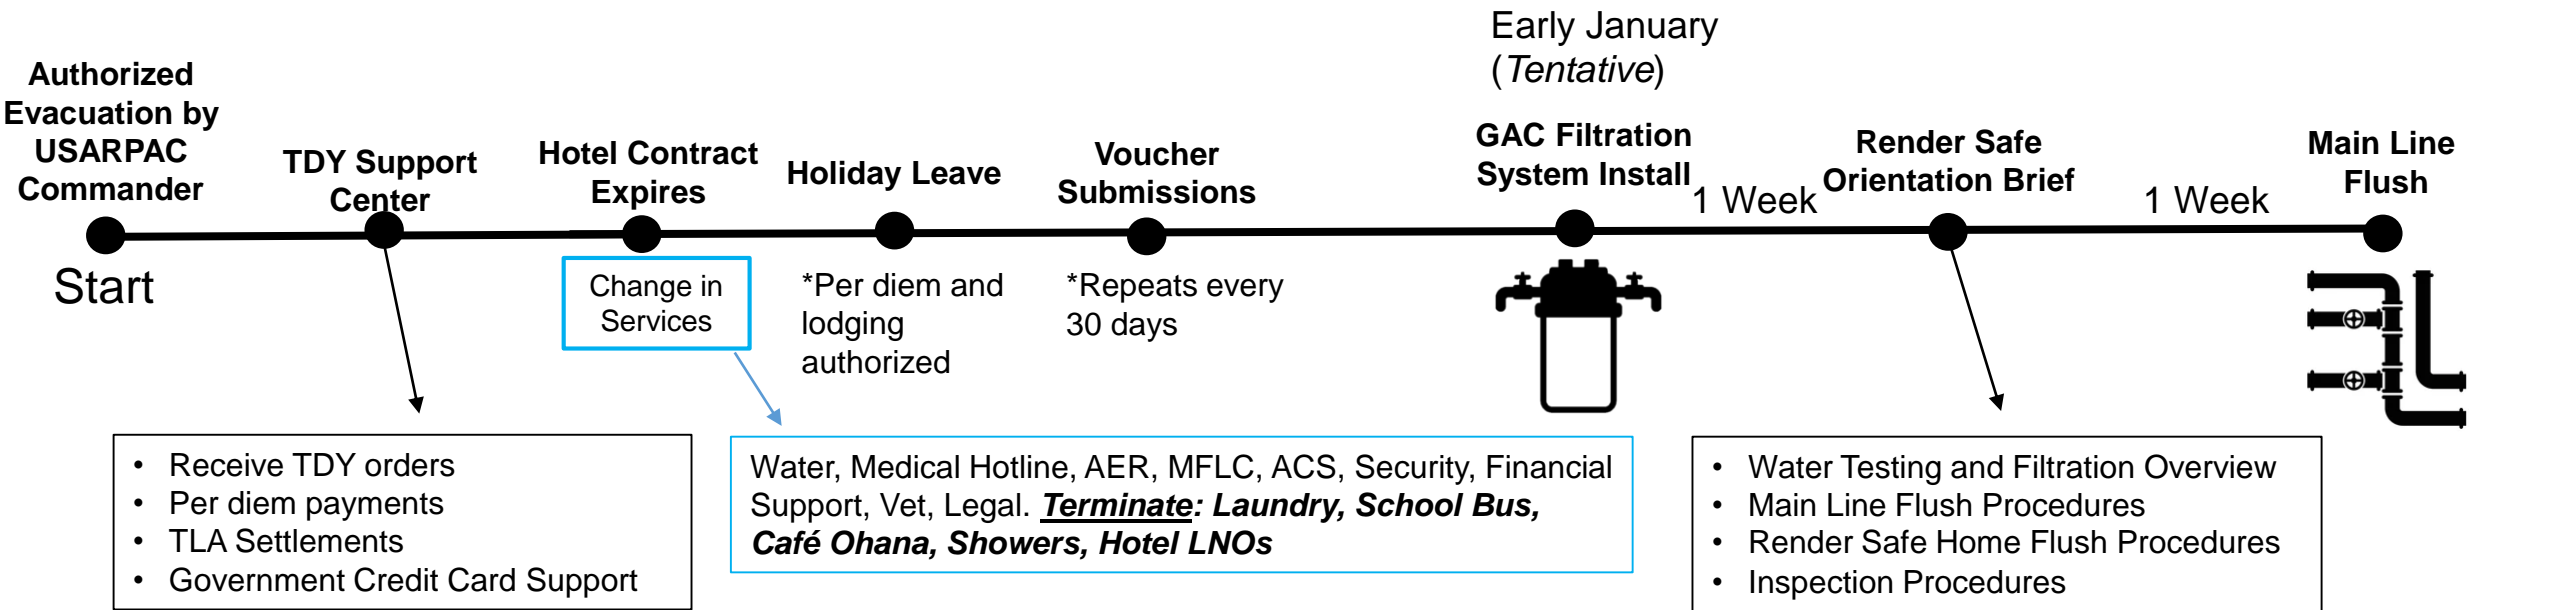

UNCLASSIFIED